FIRE SAFETY STANDARDS AND TECHNICAL NOTES FOR LICENCING APPLICATIONS

1) DOORS AND PARTITIONS REQUIRED TO BE FIRE RESISTING ARE IN ACCORDANCE WITH BS476 : 1972 AS AMENDED
2) FIRE RESISTING DOORS REQUIRED TO RESIST THE PASSAGE OF SMOKE AT AMBIENT TEMPERATURE CONDITIONS ARE UNLESS TESTED IN ACCORDANCE WITH BS476 SECTION 31 : 1983 FITTED WITH A SMOKE SEAL
3) THE FIRE ALARM SYSTEM COMPLIES WITH BS 5839 PART 1 2002 THE ATTENTION OF THE DESIGN/INSTALLING ENGINEER SHOULD BE DRAWN TO PARAGRAPH 3.1 CONSULTATIONS AND RECORDS OF BS 5839 part 1 2002 which requires consultations to be made with the fire authority
4) THE EMERGENCY LIGHTING INSTALLATION IS TO COMPLY WITH BS5266 PART 1 1999
THE ATTENTION OF THE DESIGN/INSTALLING ENGINEER SHOULD BE DRAWN TO PARAGRAPH 3.1 CONSULTATIONS AND RECORDS OF BS 5839 PART 1 2002 which requires consultations to be made with the fire authority
5) FIRE SAFETY RELATED SIGNS AND NOTICES CONFORM WITH BS5499 PART 1 1990
6) ILLUMINATED 'EXIT' SIGNS CONFORM WITH BS5266
7) FIREFIGHTING EQUIPMENT TO COMPLY WITH BS5423 1987 AND BS5306 PART 3 1985

8) UPHOLSTERED SEATING FURNITURE MUST SATISFY AS A MINIMUM STANDARD IGNITION SOURCE 0 (CIGARETTE TEST) AND CRIB 5 IGNITION SOURCE 5 AS SPECIFIED IN BS 5852 1990 "METHODS OF TEST FOR ASSESSMENT OF THE IGNITABILITY OF UPHOLSTERED SEATING BY SMOULDERING AND FLAMING IGNITION SOURCES"
IN ORDER TO SOURCE COMPLIANCE WITH THE ABOVE STANDARDS THE FABRIC SUBMITTED FOR TEST HAS BEEN TESTED BEFORE AND WITH A FIRE RETARDANT PRODUCT. THE TESTING LABORATORY MUST BE INSTRUCTED TO SUBJECT THE SAMPLES SO TREATED TO WATER SOAK TEST IN ACCORDANCE WITH BS5651 1998 PARAGRAPH 5 BEFORE THE BS 5852 TESTS ARE CARRIED OUT
9) A COPY OF THE LABORATORY TEST REPORT FROM AN ACCREDITED TESTING LABORATORY IDENTIFYING COMPLIANCE OF THE FLAME SHALL CEASPOSITE WITH THE ABOVE MENTIONED BRITISH STANDARDS MUST BE FORWARDED TO THIS AUTHORITY BEFORE INSTALLATION AND CONFIRMATION THAT THE FLAME SHALL SPECIFIED IN THIS CERTIFICATE HAVE BEEN INSTALLED IN THE PREMISES
10) CURTAINS AND OTHER TEXTILE HANGINGS MUST BE INHERENTLY FLAME RETARDANT OR BE TREATED WITH A DURABLE FLAME RETARDANT. THEY MUST CAPABLE OF COMPLYING WITH "TYPE B" PERFORMANCE REQUIREMENTS AS SET OUT BY BS5867 PART 2 1980 "SPECIFICATION FOR FABRICS FOR CURTAINS AND DRAPES. FLAMMABILITY REQUIREMENTS"

10) ARTIFICIAL FOLIAGE AND OTHER DECORATIVE EFFECTS ARE TO BE FIRE RETARDANT TO THE SATISFACTION OF THE FIRE AUTHORITY
11) LININGS AND SURFACE FINISHES OF WALLS AND CEILINGS HAVE A SURFACE SPREAD OF FLAME RATING AS DEFINED IN THE BUILDING REGS 1991
12) TEXTILE FLOOR COVERINGS CONFORM TO BS5287 WHEN TESTED IN ACCORDANCE WITH BS4790 1987
13) CERTIFICATES OF INSTALLATION TEST WILL BE REQUIRED IN RESPECT OF ITEMS NUMBERED 5 6 8 9 AND 9 ABOVE AND MAY BE REQUIRED FOR ITEM 2
14) ALL FIRE ESCAPE DOORS TO INCORPORATE PANIC TYPE OPERATING LATCHES FOR EMERGENCY ESCAPE

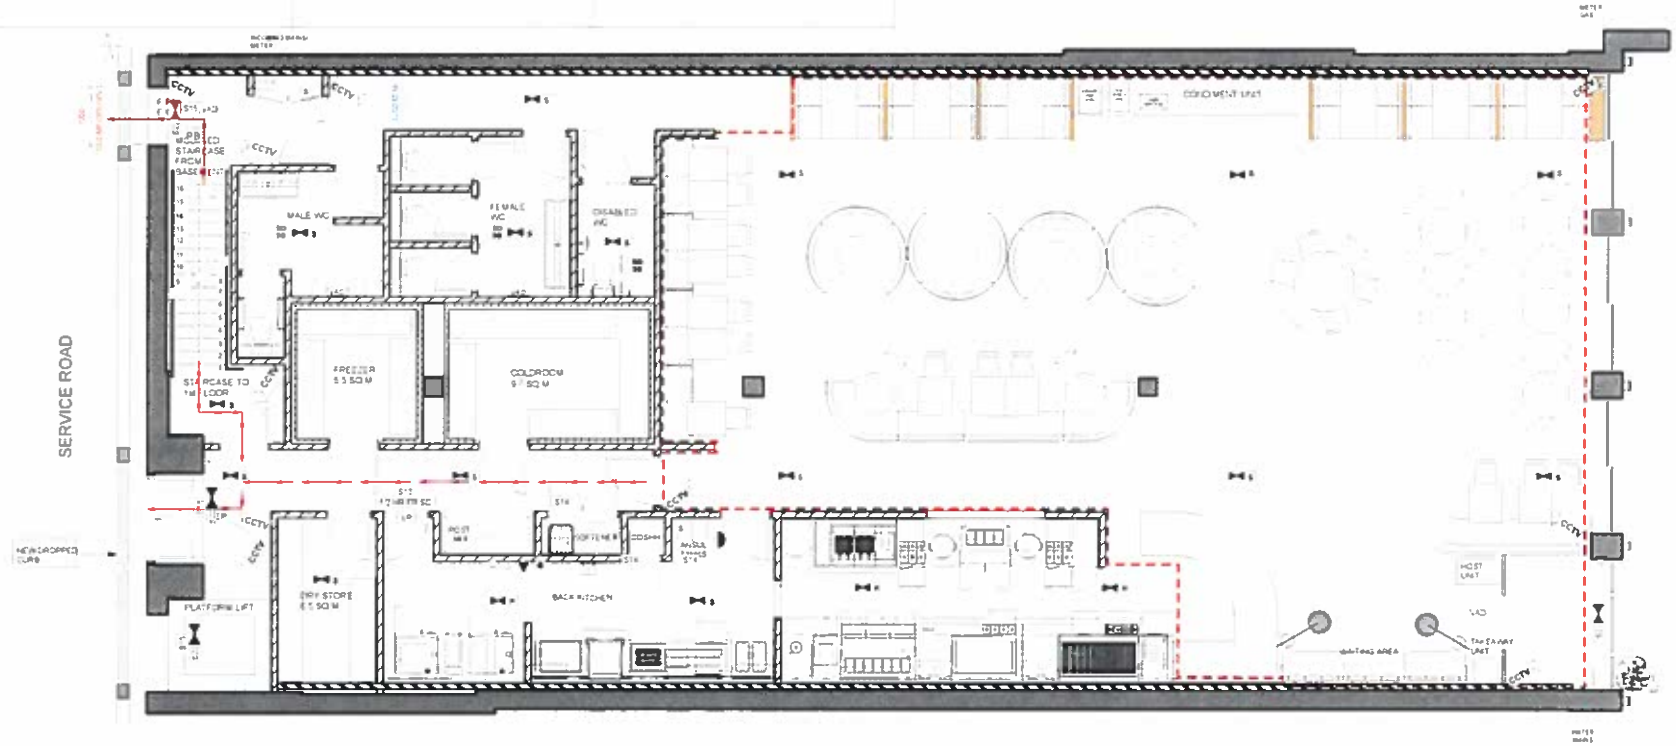

GROUND FLOOR LICENSING PLAN 1:50

Notes

This drawing should not be scaled. The contractor is to verify all dimensions and conditions on site. This drawing is the property of Fusion and they reserve the copyright. It is issued on the understanding that it will not be copied, reproduced or disclosed or issued or in part to any unauthorised party without written permission from Fusion.

KEY - FIRE SAFTEY

	ALARM SOUNDER
	FIRE INDICATOR PANEL
	EMERGENCY LIGHTING 3 HOUR NON MAINTAINED
S	SMOKE DETECTOR
H	HEAT DETECTOR
VD	VOICE DETECTION
	CO2 EXTINGUISHER
	FOAM EXTINGUISHER
	WATER EXTINGUISHER
	WET CHEMICAL EXTINGUISHER
	CALL POINT
	FIRE BLANKET
1/2 HR FR SC	1/2 HOUR FIRE RESISTANT SELF CLOSING DOOR WITH SMOKE SEALS AND INTUMESCENT STRIPS
1 HR FR SC	1 HOUR FIRE RESISTANT SELF CLOSING DOOR WITH SMOKE SEALS AND INTUMESCENT STRIPS
PB	FIRE EXIT DOORS FITTED WITH EMERGENCY PUSH BAR FACILITY
SF	SIMPLE FASTENING
VP	VISION PANEL
VAD	VISUAL ALARM DEVISE
EXIT	SIGN EMERGENCY EXIT NOTICE INDICATES THAT THE NOTICE IS INTERNALLY ILLUMINATED
S10	SIGN FIRE DOOR KEEP SHUT
S14	SIGN FIRE DOOR KEEP LOCKED
S15	SIGN FIRE DOOR KEEP CLEAR
	POINT OF ENTRY/EXIT FOR CUSTOMER ACCESS
CCTV	CCTV CAMERA EXACT POSITIONS TBC
	INDICATES EXTENT OF LICENSABLE ACTIVITIES
	FIRE ESCAPE ROUTE

B 23.03.16 GENERAL UPDATES
A 11.03.16 GENERAL UPDATES

FUSION

NANDO'S STANMORE

THE BROADWAY
STANMORE
HA7 4EB

LICENSING PLAN

FOR INFORMATION

EM	MC
1:100 @ A3 / 1:50 @ A1	MAR 16

112/53- 205 B