

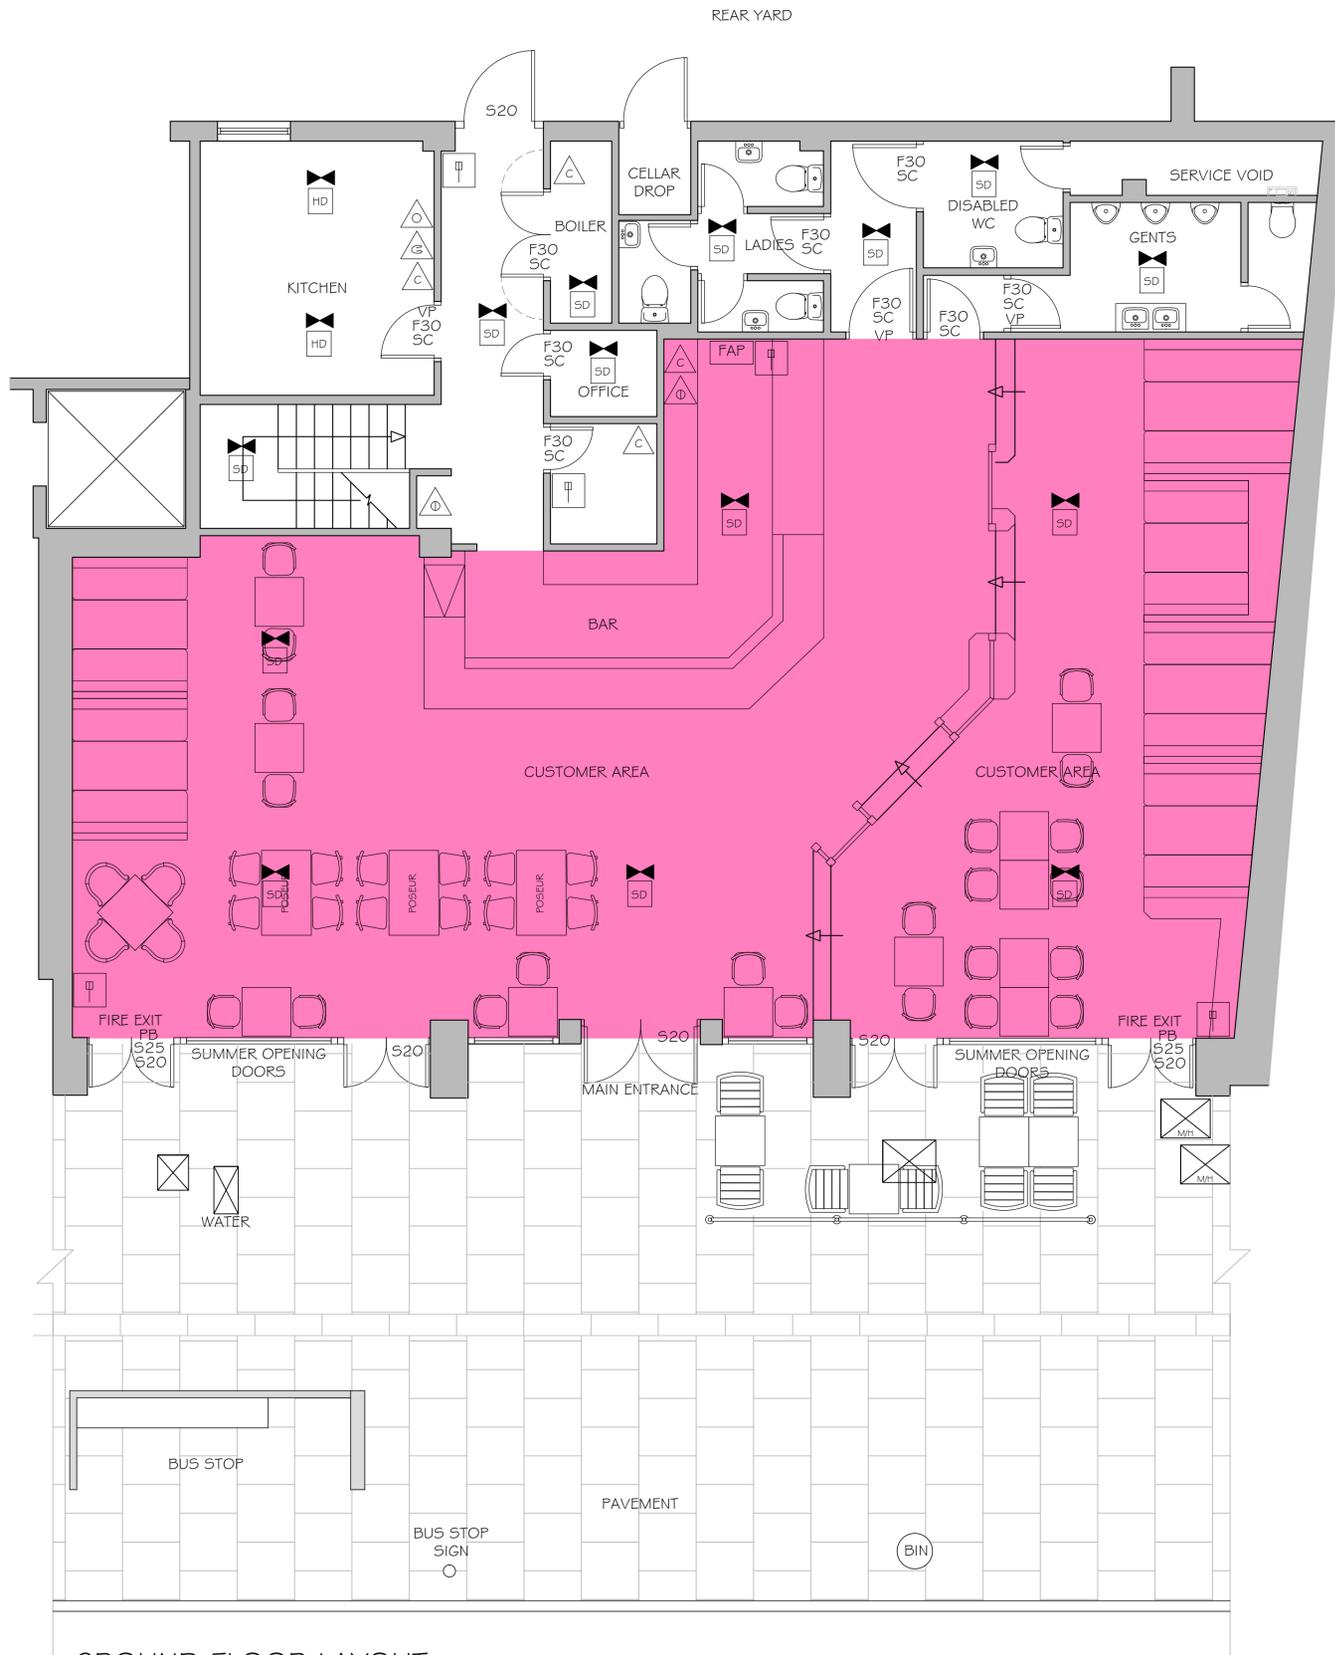


NOTE - Responsibility is not accepted for errors made by others in scaling from this drawing. All construction information should be taken from figured dimensions only

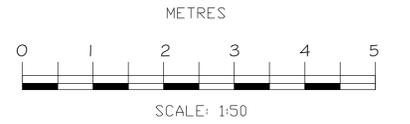

GROUND FLOOR LAYOUT

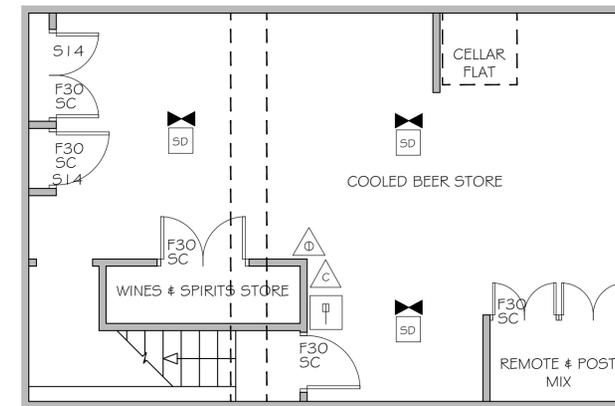

BASEMENT LAYOUT

ALL WALLS AND PARTITIONS TO BE MINIMUM HALF HOUR FIRE RESISTANCE.
EMERGENCY LIGHTING TO COMPLY WITH 2005 EDITION OF BS 5266 PART 1.
FIRE SAFETY RELATED SIGNS AND NOTICES TO COMPLY WITH THE HEALTH AND SAFETY (SAFETY SIGN AND SIGNAL) REGULATIONS 2005
FIRE ALARM AND DETECTION SYSTEM TO BE INSTALLED TO BS 5839 PART 1 2002

FIRE FIGHTING EQUIPMENT TO COMPLY WITH BS 5306 WALL AND CEILING LININGS ARE TO BE CLASS 1 SURFACE SPREAD OF FLAME (AS DEFINED BY BS 476 PART 7) IN PUBLIC AREAS AND CLASS 0 IN ESCAPE ROUTES.
UPHOLSTERED SEAT FURNITURE TO SATISFY THE FOLLOWING
* IGNITION SOURCE (CIGARETTE TEST) AS SPECIFIED IN BS 5852 PART 1 FIRE TEST FOR FURNITURE METHODS OF TEST FOR THE IGNABILITY BY SMOKERS.
* BS 5852 PART 2 FIRE TEST FOR FURNITURE-METHODS OF TEST FOR THE IGNABILITY OF UPHOLSTERED COMPOSITES FOR TESTING BY FLAMING SOURCE, MINIMUM TEST TO BE CRIB IGNITION SOURCE 5.

FABRICS THAT HAVE HAD A FLAME RETARDANT TREATMENT TO PASS THE WATER SOAK TEST AS DEFINED BY BS 5651 TEST CERTIFICATE TO BE SUBMITTED TO FIRE AUTHORITY.

CURTAINS AND DRAPES TO SATISFY TYPE B PERFORMANCE REQUIREMENTS TO BS 5867 PART 2.

ARTIFICIAL FOLIAGE AND DECORATIVE EFFECTS TO BE FIRE RETARDANT TO THE SATISFACTION OF THE FIRE AUTHORITY.

AREA FOR REGULATED ENTERTAINMENT/ SALE BY RETAIL OF ALCOHOL/ PROVISION OF LATE NIGHT REFRESHMENT

- | | | | |
|-----|---|--|--|
| F20 | TWENTY MINS FIRE RESISTANT WITH SMOKE SEALS AND INTUMESCENT STRIP | | FIRE ALARM CALL POINT |
| F30 | HALF HOUR FIRE RESISTANT WITH SMOKE SEALS AND INTUMESCENT STRIP | | FIRE ALARM CONTROL PANEL |
| F60 | ONE HOUR FIRE RESISTANT WITH SMOKE SEALS AND INTUMESCENT STRIP | | FIRE ALARM BELL /SOUNDER |
| VP | VISION PANEL | | CARBON DIOXIDE FIRE EXTINGUISHER |
| PP | PANIC PAD | | 9 LITRE WATER FIRE EXTINGUISHER |
| PB | PANIC BAR | | DRY POWDER FIRE EXTINGUISHER |
| SC | SELF CLOSING | | FOAM FIRE EXTINGUISHER |
| SCA | SELF CLOSING AUTOMATIC RELEASE | | FIRE BLANKET |
| FL | FUSIBLE LINK | | FIRE RESISTING GLAZING ELEMENT |
| DS | DOOR SELECTOR | | AREA COVERED BY ESCAPE LIGHTING TO BS.5266, PART 1 |
| | ILLUMINATED EMERGENCY FITTING WITH RUNNING PERSON SYMBOL+ARROW | | AREA COVERED BY SMOKE DETECTOR |
| | NON MAINTAINED EMERGENCY FLOODLIGHTING CW BATTERY PACK | | AREA COVERED BY HEAT DETECTOR |
| S13 | 'FIRE DOOR KEEP SHUT' 10mm LETTERS TO BOTH SIDES OF DOOR LEAF | | |
| S14 | 'FIRE DOOR KEEP LOCKED' 10mm LETTERS TO BOTH SIDES OF DOOR LEAF | | |
| S20 | 'FIRE ESCAPE KEEP CLEAR' 10mm LETTERS TO BOTH SIDES OF DOOR LEAF | | |
| S22 | RUNNING PERSON SYMBOL+ARROW | | |
| S25 | 'PUSH BAR TO OPEN' 20mm LETTERS | | |
| S26 | DIRECTIONAL ARROW (GREEN) | | |



K d paine & associates ltd
architectural & construction consultants
project managers interior designers
Adur Business Centre Little High Street,
Shoreham by Sea, West Sussex, BN43 5EG.
t: +44 (0)1273 467518 f: +44 (0)1273 467520
e-mail: info@kdpaine.co.uk

CLIENT JD WETHERSPOON PLC
PROJECT PUB NO: 38 MOON ON THE HILL HARROW
DRAWING PROPOSED LICENSING LAYOUTS

SCALE	DATE	DRAWN
A/1:50	JUL 2013	AKS
PROJECT No	DRAWING No	REVISION
G961	L-01	